


FIG. 1

BLC FLOW DIAGRAM FOR WATER TREATMENT SYSTEM

FIG. 2

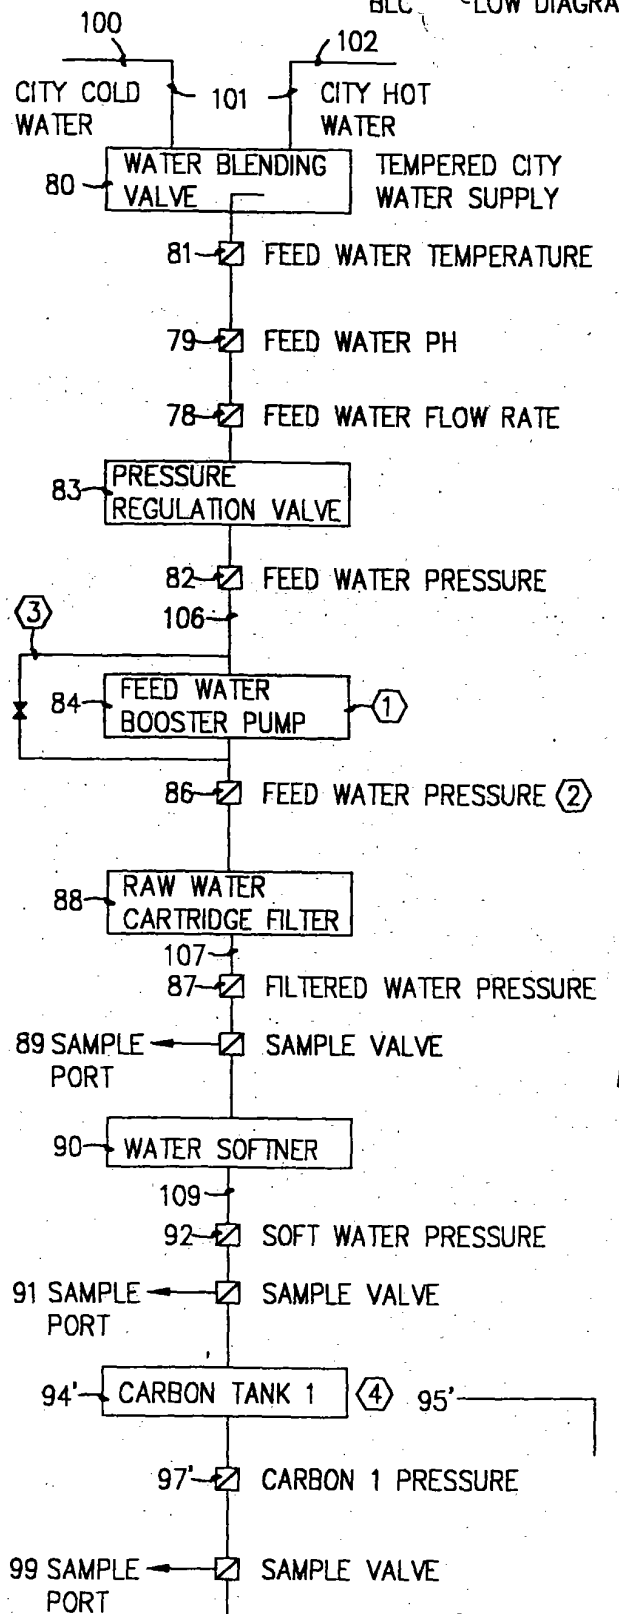

PROCESS UNIT


MONITOR ELEMENT

(1) OPTIONAL DEPENDING ON CITY WATER PRESSURE.

(2) OPTIONAL, INCORPORATED IF BOOSTER PUMP USED.

(3) PUMP BYPASS (OPTIONAL).


(4) OPTION TO BACKWASH CARBON TANK. BACKWASH TO DRAIN, 104.

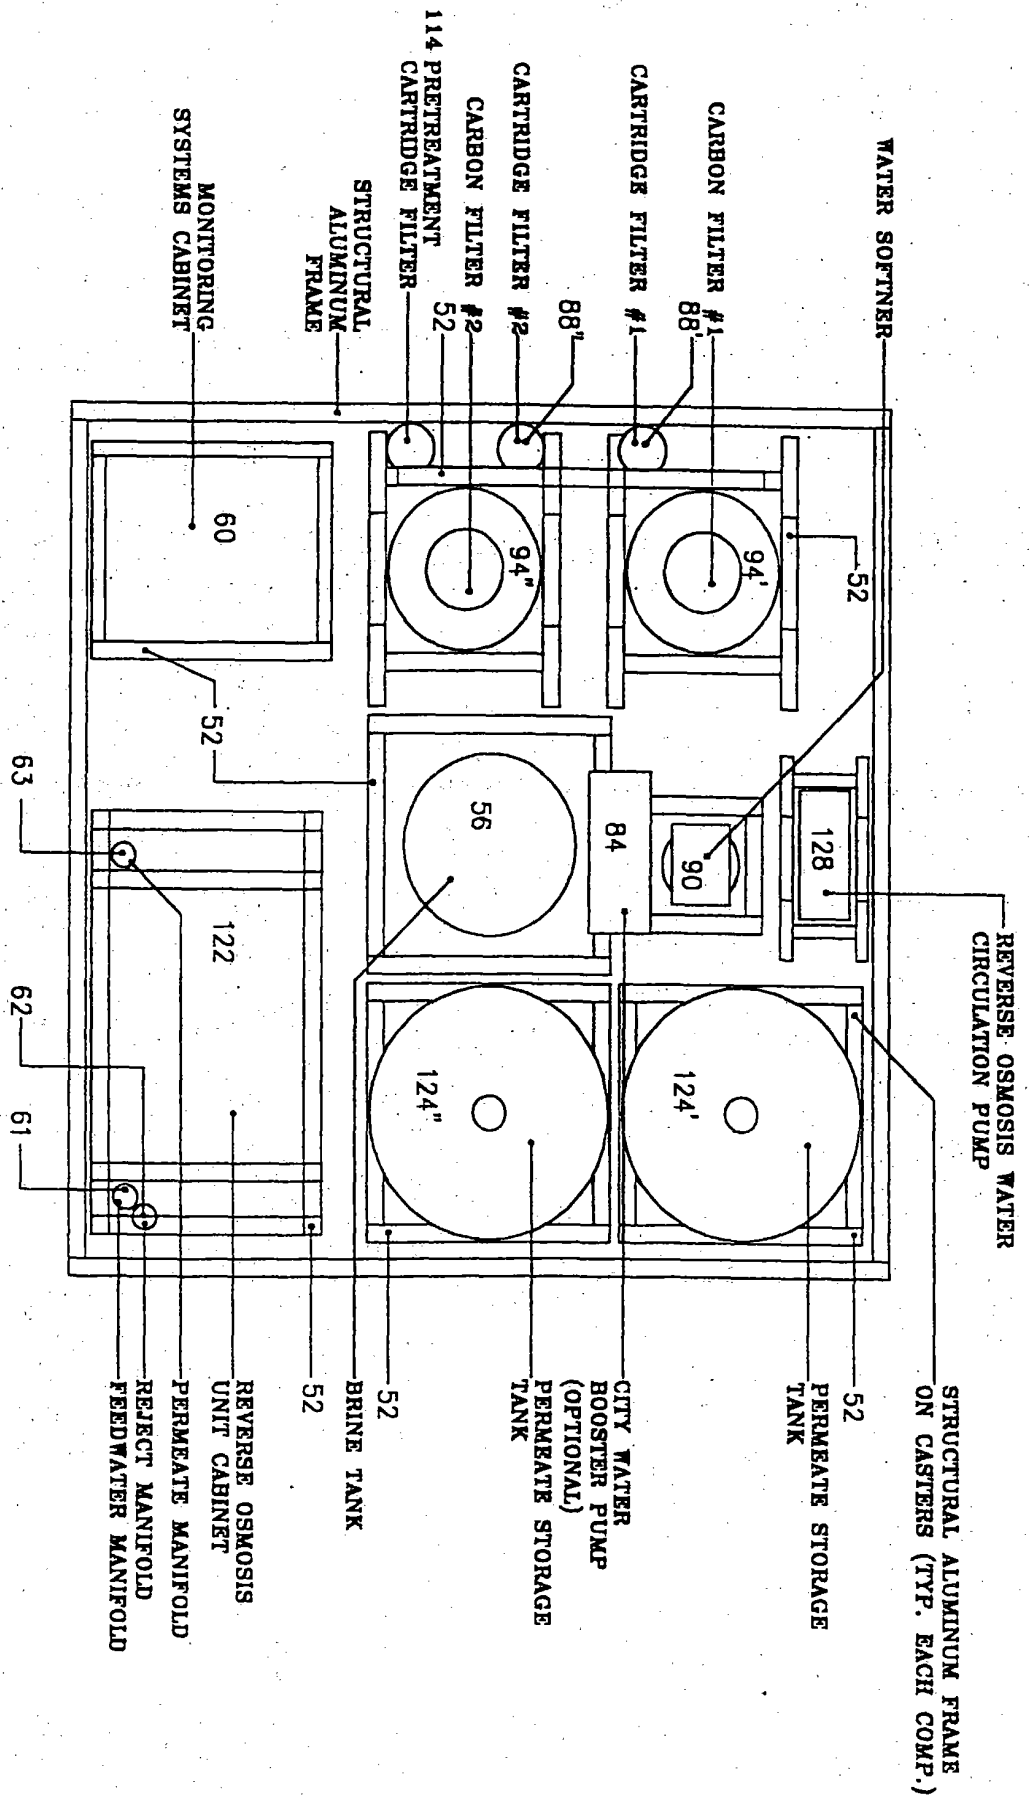

TOP VIEW


FIG. 3

10

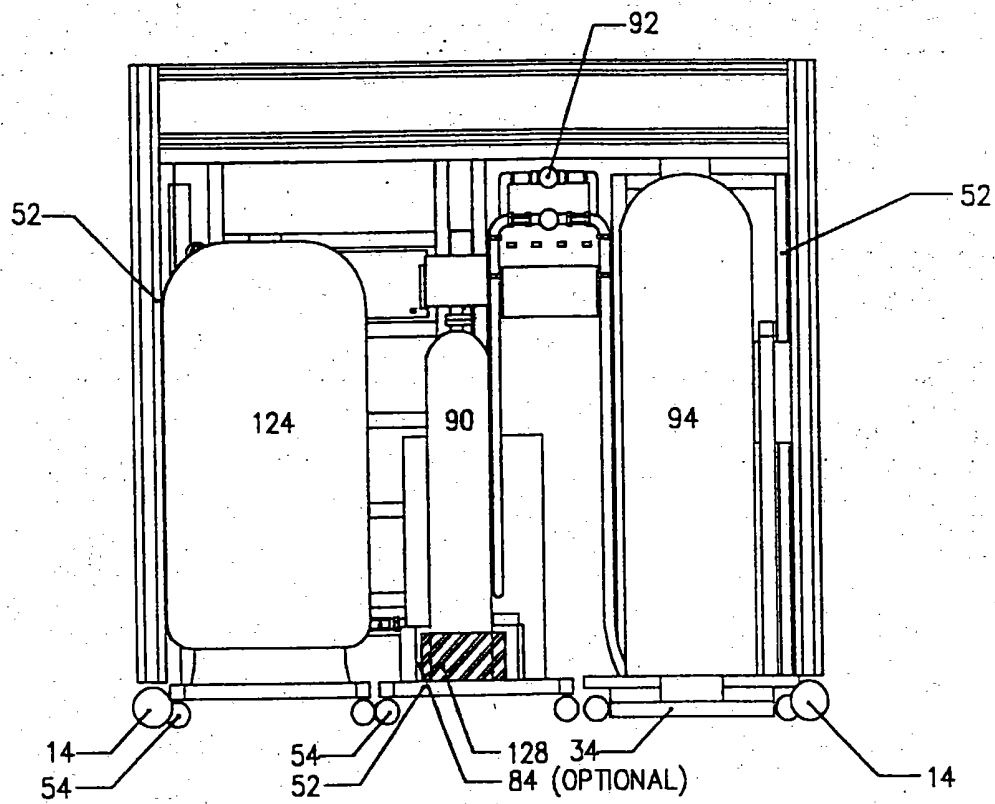


REAR VIEW
NTS

FIG. 4

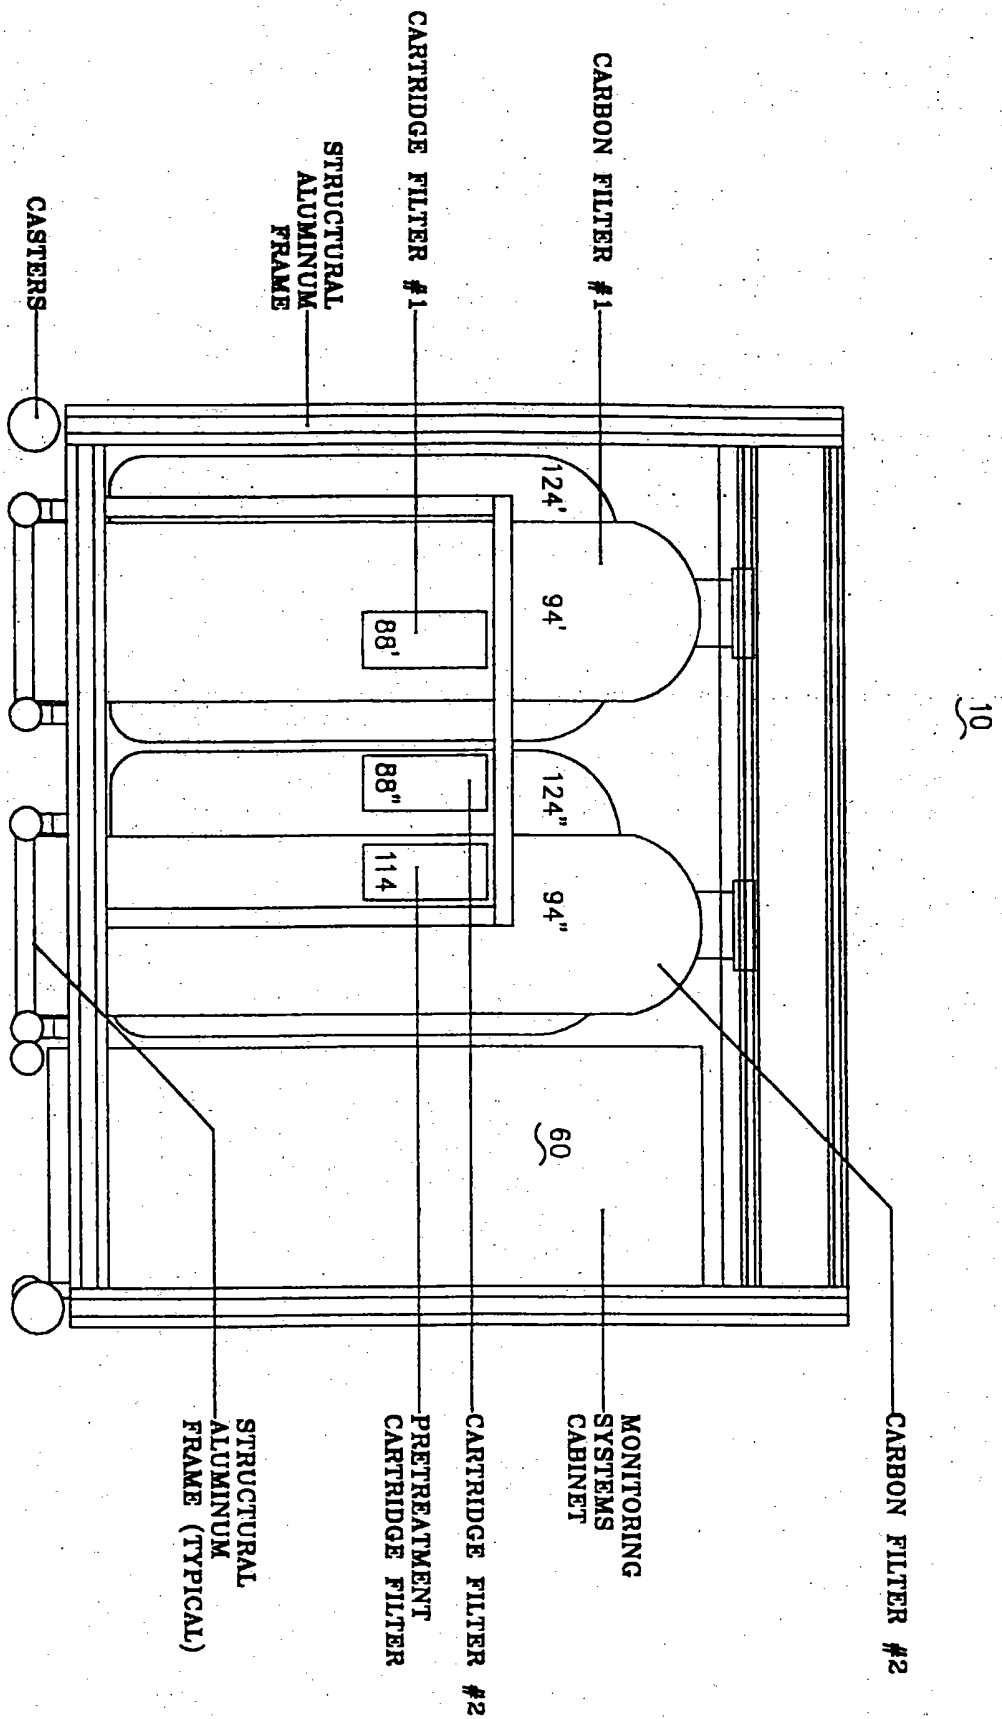


LEFT VIEW

FIG. 5

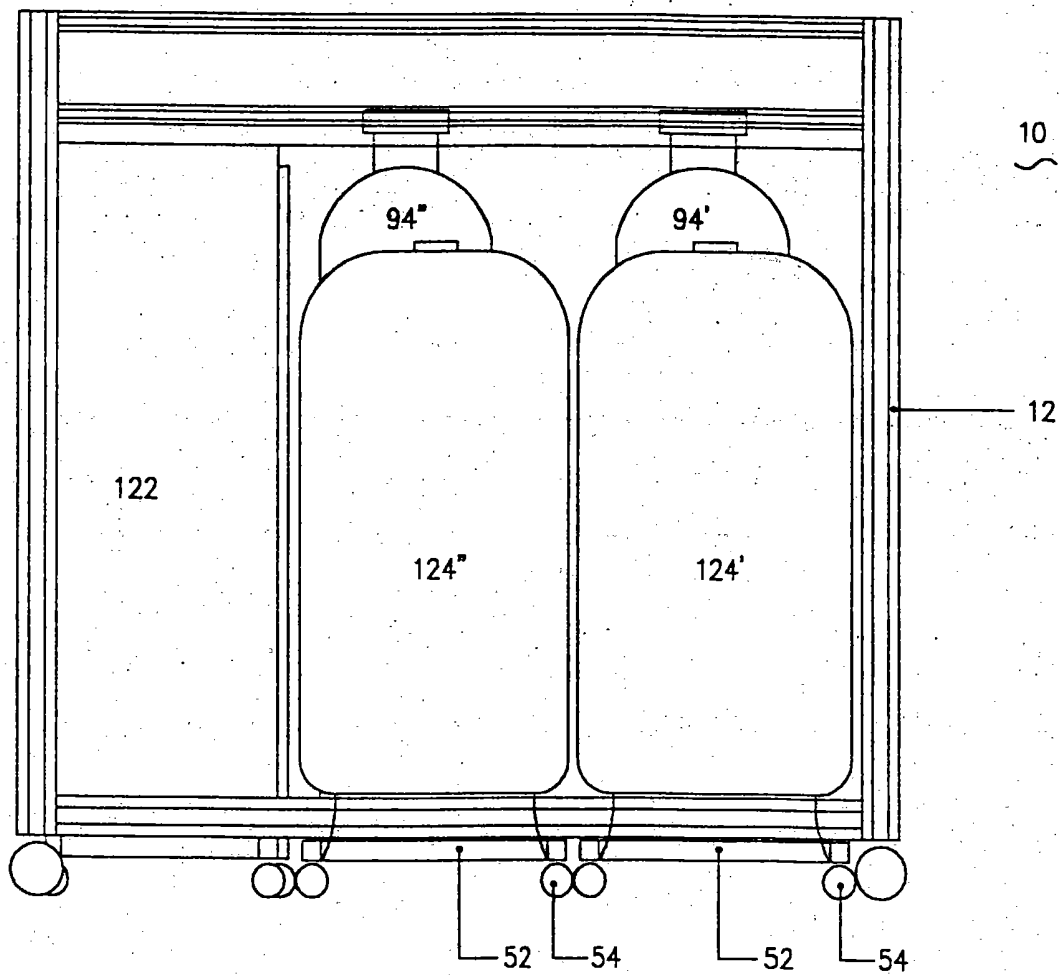

RIGHT VIEW

FIG. 6

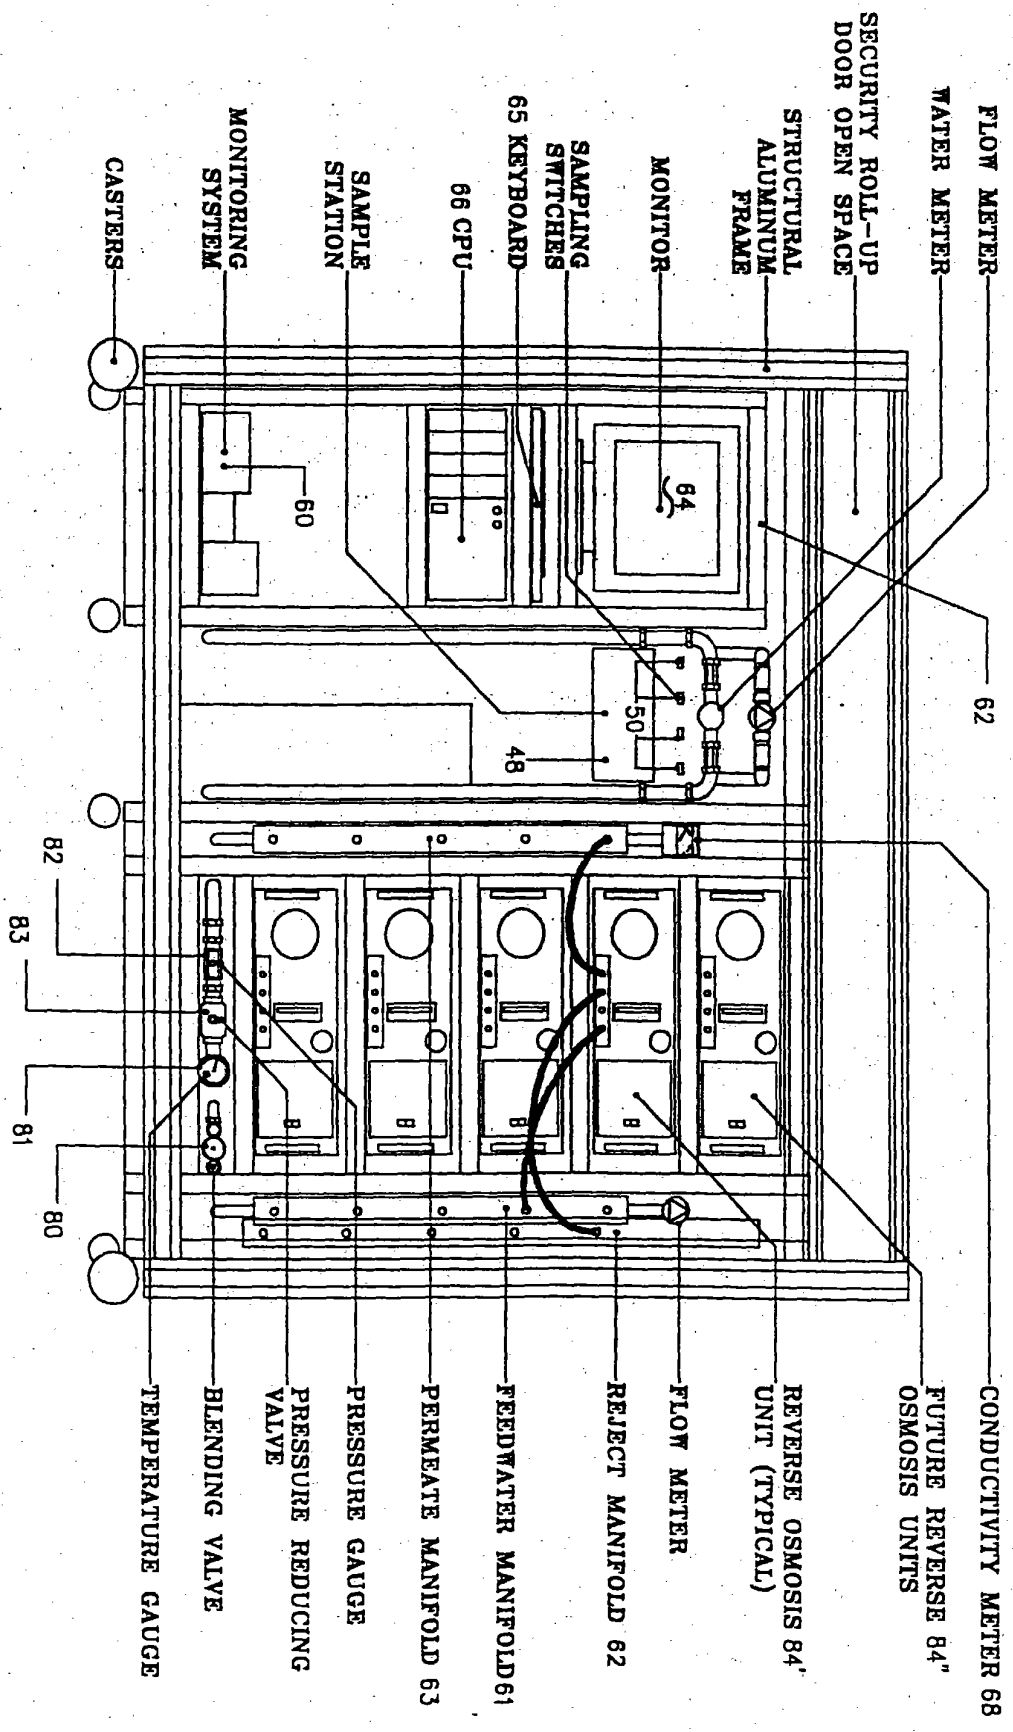

FRONT VIEW

FIG. 7